

RESOLUTION R-2002-076

**REQUEST FOR PERMISSION TO GRANT AN EASEMENT TO SCE & G COMPANY FOR THE
INSTALLATION OF UTILITIES ALONG A PORTION OF THE CITY'S PROPERTY ON ADAMS
GROVE, IDENTIFIED AS RICHLAND COUNTY
TMS#11503-06-29; CF#250-142**

WHEREAS, SCE & G Company (also hereinafter referred to as South Carolina Electric & Gas Company) needs an easement to provide service to the FMC Dialysis Center under construction on Adams Grove adjacent to the City's property. SCE & G will install anchor wires and appurtenances on the existing power pole located on the City's property; and

WHEREAS, the request has been reviewed by the Engineering Division and there are no conflicts with existing City utilities. Also, the Utilities Department has reviewed the request and has no objections; NOW, THEREFORE,

BE IT RESOLVED by the Mayor and City Council this 13th day of November, 2002, for and in consideration of the sum of One (\$1.00) Dollar, each to the other paid, the City Manager is hereby authorized to execute an easement on behalf of the City of Columbia to SOUTH CAROLINA ELECTRIC & GAS COMPANY for ingress, egress, installation and maintenance of anchor wires and appurtenances to the existing power pole located on the referenced property.

The referenced easement is shown on a drawing prepared for service to the FMC Dialysis Center by South Carolina Electric & Gas Company, dated September 27, 2002, and being on file in the office of the City's Director of Engineering under file reference #250-142.

Requested by:

Engineering Department



Mayor

Approved by:

City Manager

Approved as to form:

City Attorney

ATTEST:

City Clerk


Introduced 11/13/2002

Final Reading 11/13/2002

ORIGINAL
STAMPED IN RED

EASEMENT PLAT FOR INSTALLATION OF UTILITIES ALG PORT. CITY'S PROPERTY IDENTIFIED AS RICHLAND COUNTY TMS#11503-06-29 ON ADAMS GROVE; CF#250-142

POLE#
S-45'-4
-DE FIBERXARM
2-10" SCREW ANC
38'&32' LEADS
3-50KVA
120/208 3PH
S-500QUAD TO CUSTOMER
POLE

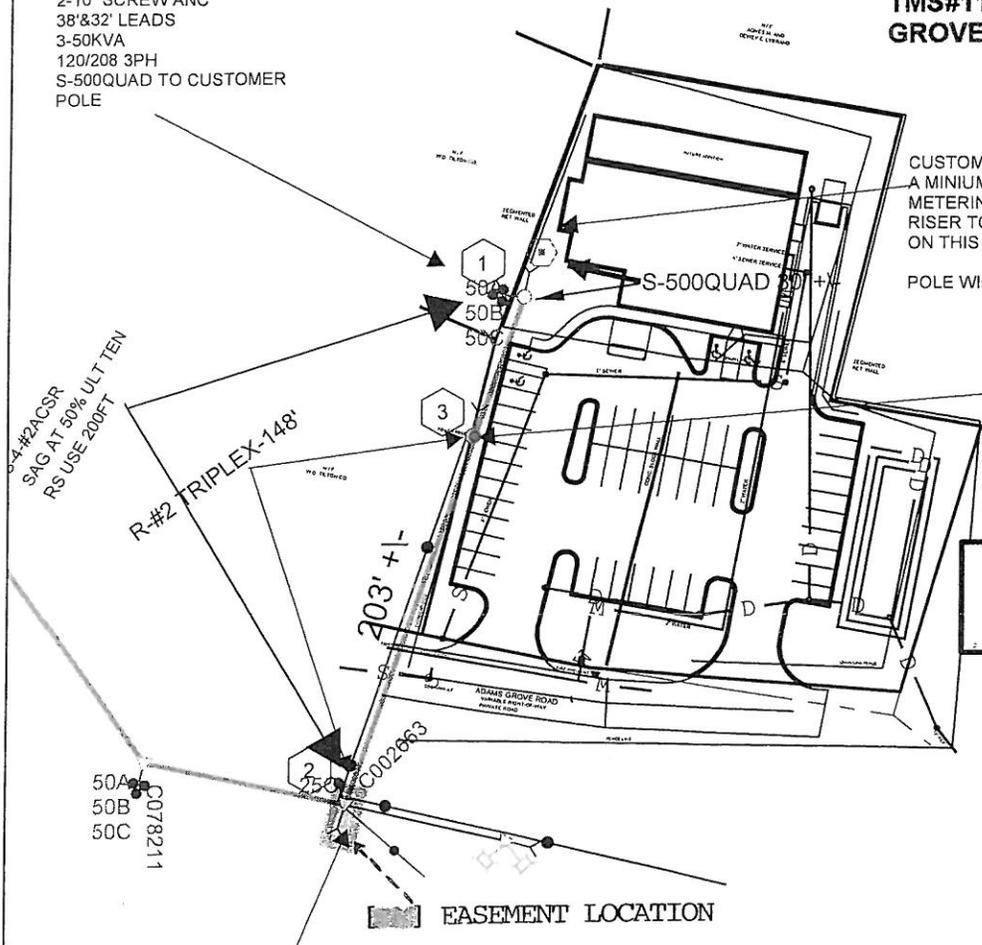

CUSTOMER TO INSTALL
A MINIMUM 30FT CL 5 POLE FOR
METERING POLE AND SECONDARY
RISER TO SERVE BLDG. METERING WILL BE
ON THIS POLE.

POLE WILL BE CUSTOMER OWNED

Pole # 12174
R-30'5
-PBI
-8" SCREW ANC
"C"DG

The developer will be fully responsible for compliance with any tree ordinances on SCE&G easements. Any pruning or tree replacement will be the responsibility of the developer. The developer should make himself fully aware of all appropriate ordinances which can affect SCE&G's right of way and should take this into account when assigning the easement.

CUSTOMER'S RESPONSIBILITY FOR 3-PHASE MOTOR PROTECTION
It is the Customer's responsibility to protect his 3 phase motors from single phasing conditions which could occur due to a fault condition on incoming S.C.E. & G. Co. Power Lines.

CUSTOMER'S RESPONSIBILITY FOR FINAL GRADE
It is the Customer's responsibility to furnish the grade for all S.C.E. & G. Co. equipment. It is essential that all handholes, manholes, and any other equipment be installed to grade correctly. If this equipment has to be raised or lowered due to insufficient information from the Customer, the Customer will be responsible for reimbursing S.C.E. & G. Co. for this cost.

C-2663
45'4
DE FIBER X-ARM
LOWER 25 KVA
S-DE FIBER X-ARM
2-10" SCREW ANCS
2-"B" DG'S
1-"C" DG

ALL SCE&G FACILITY LOCATIONS SHOWN ARE APPROXIMATE
EXACT LOCATIONS TO BE DETERMINED AT TIME OF
INSTALLATION AND RIGHT OF WAY WILL BE AT INSTALLED
LOCATIONS.

WR#1954001316
WO#1066

Designer: DERRICK, WILLIAM C

Design Date: _____

WD05617
10/9/2002

TRANSFORMER INSTALLED		Spec					
Company #	Serial #	KVA	Type	Ph	Con	RFA	

TRANSFORMER REMOVED		Spec					
Company #	Serial #	KVA	Type	Ph	Con	RFA	

SUB: 00477	TRUCK ACCESS? Y/N	R-SWITCH REQUIRED? Y/N	WHITE-X CUST. AFFECTED? Y/N
CKT: 00790	PUPS #: _____	CUSTOMER: FMC DIALYSIS CENTER	
SECT: _____	DATE: _____	ADDRESS: _____	
TAP: _____	TIME: _____		
PHASE: _____	Sketch Corrected	NAME: _____	POINT ID: _____
SEC. VOLT: _____	to Agree with	CREW ID: _____	WORK REQ.#: 195400131624
	Construction	DATE: _____	